




Closed  
to create two  
separate air circuits

Installed




TEI Fluidizer Field Test Unit

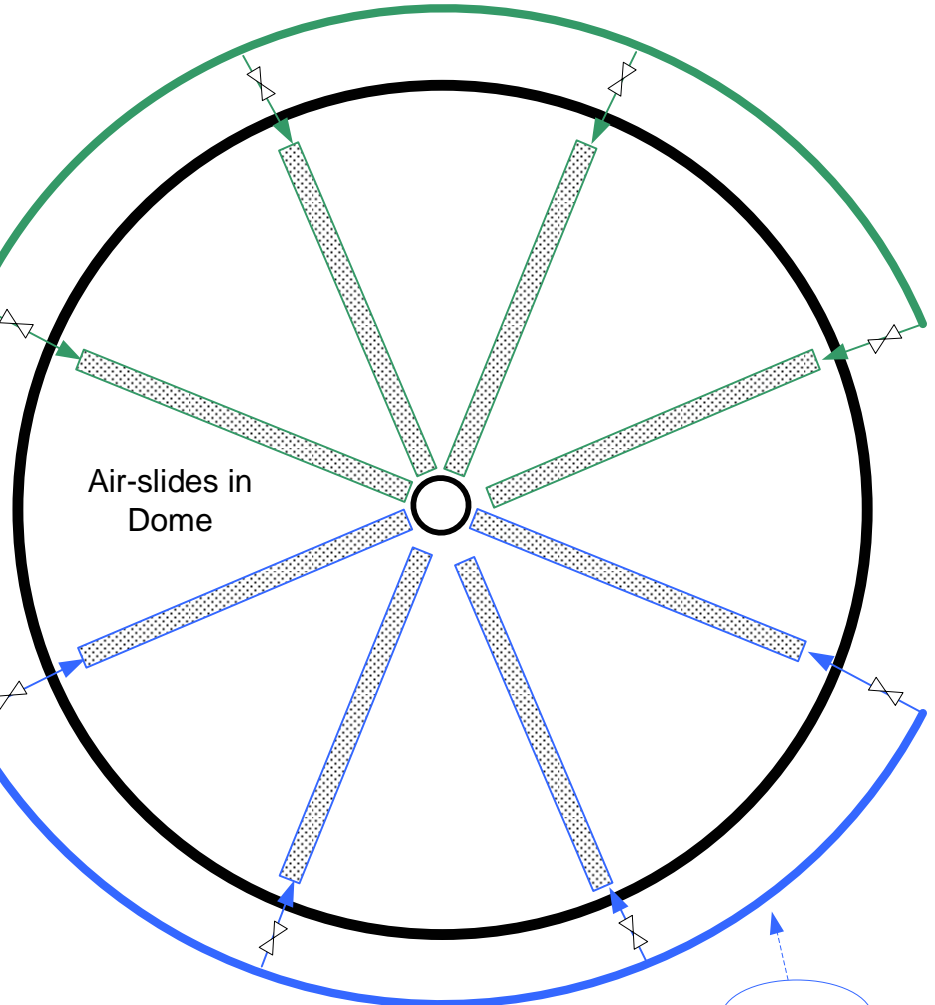


Air-slides in  
Dome

Air Circuit #2

Before



Blower

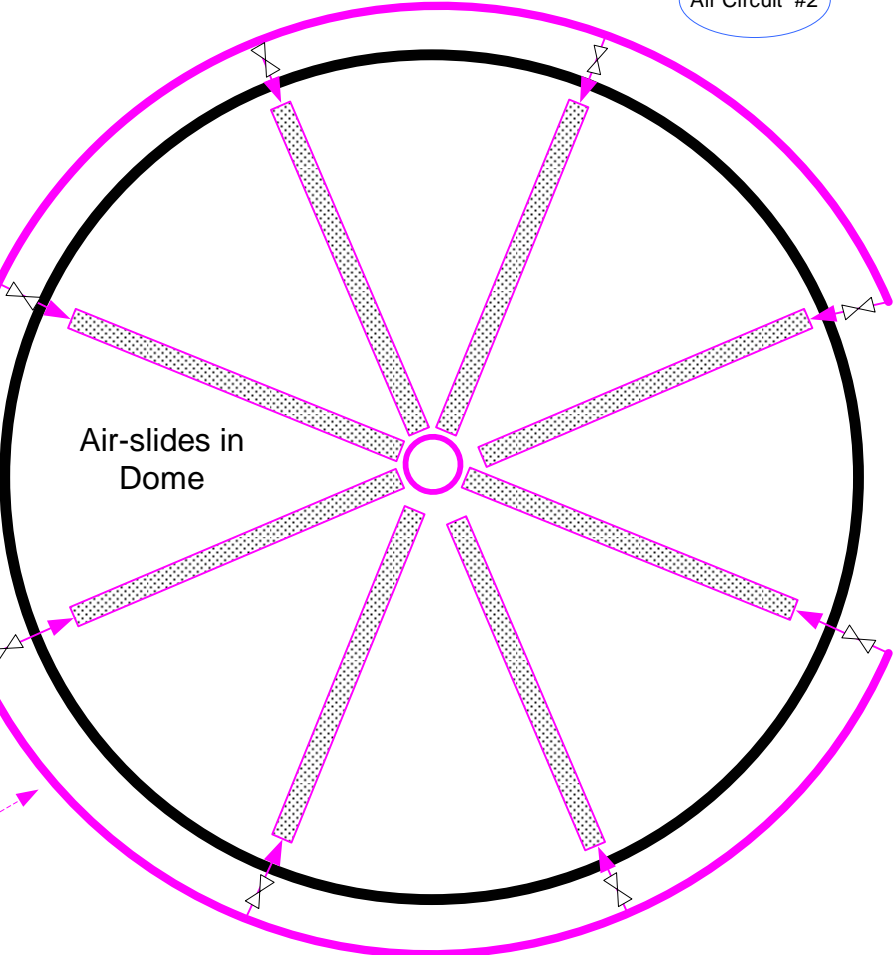

Air-slides in  
Dome

Single Air  
Circuit